


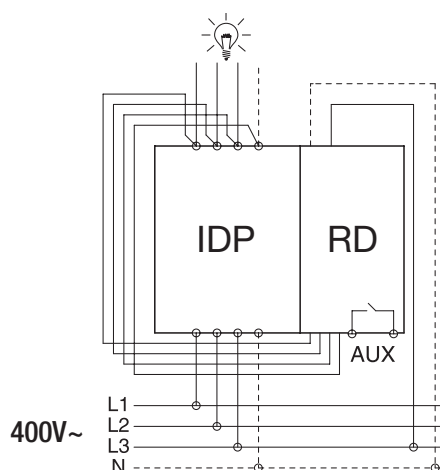


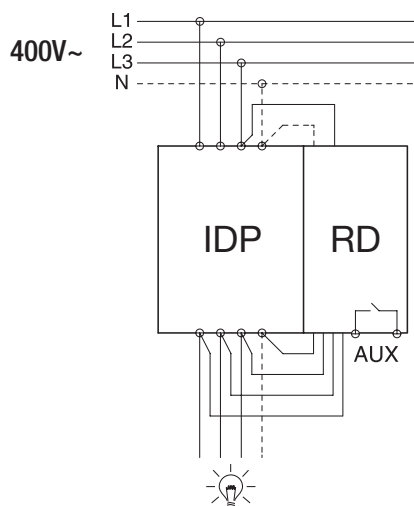


A

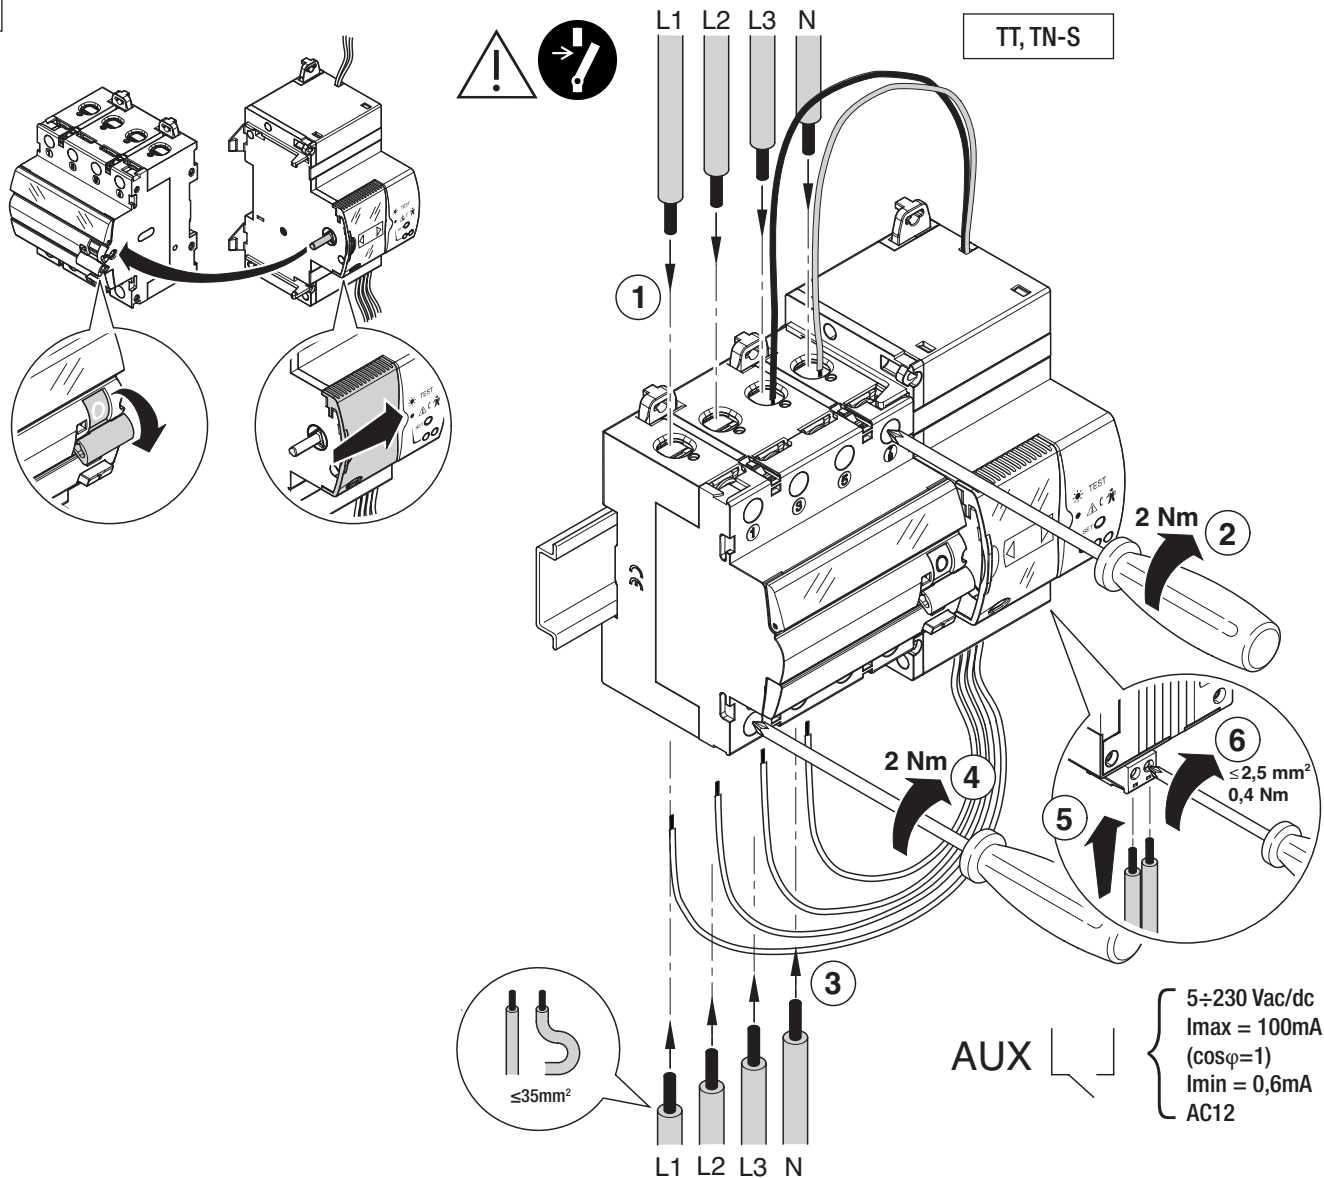


OFF→ON

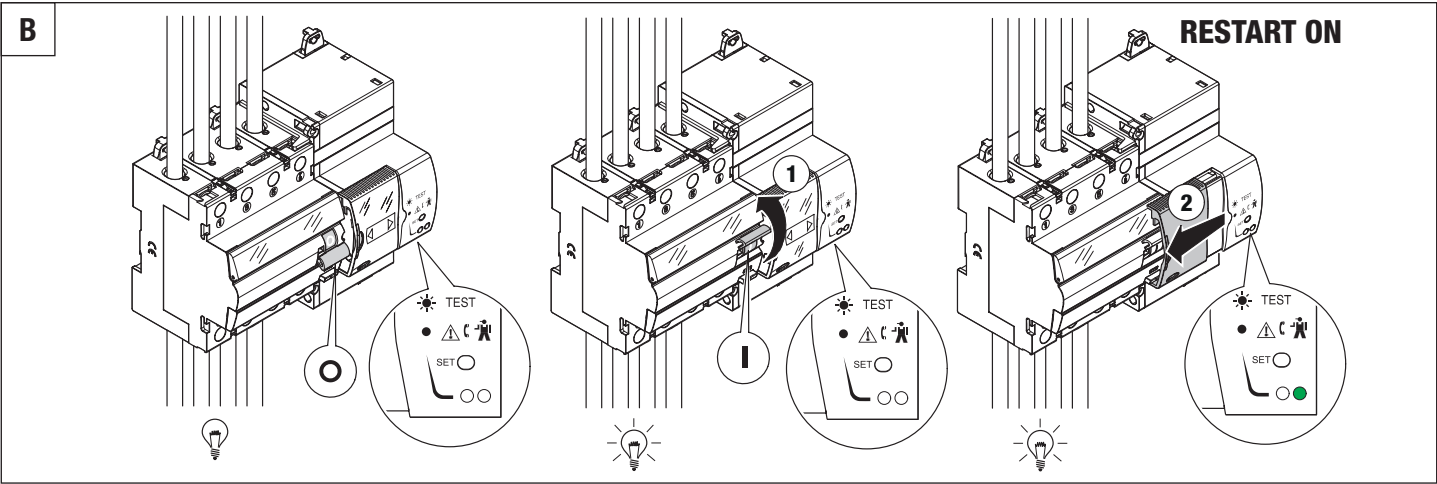

ON→OFF

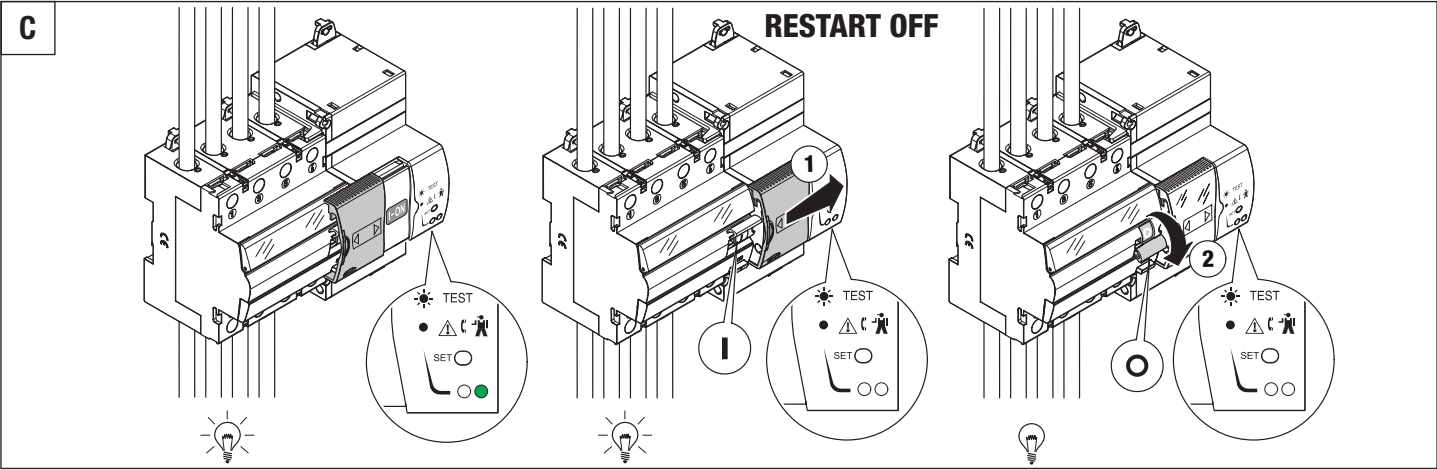

TEST

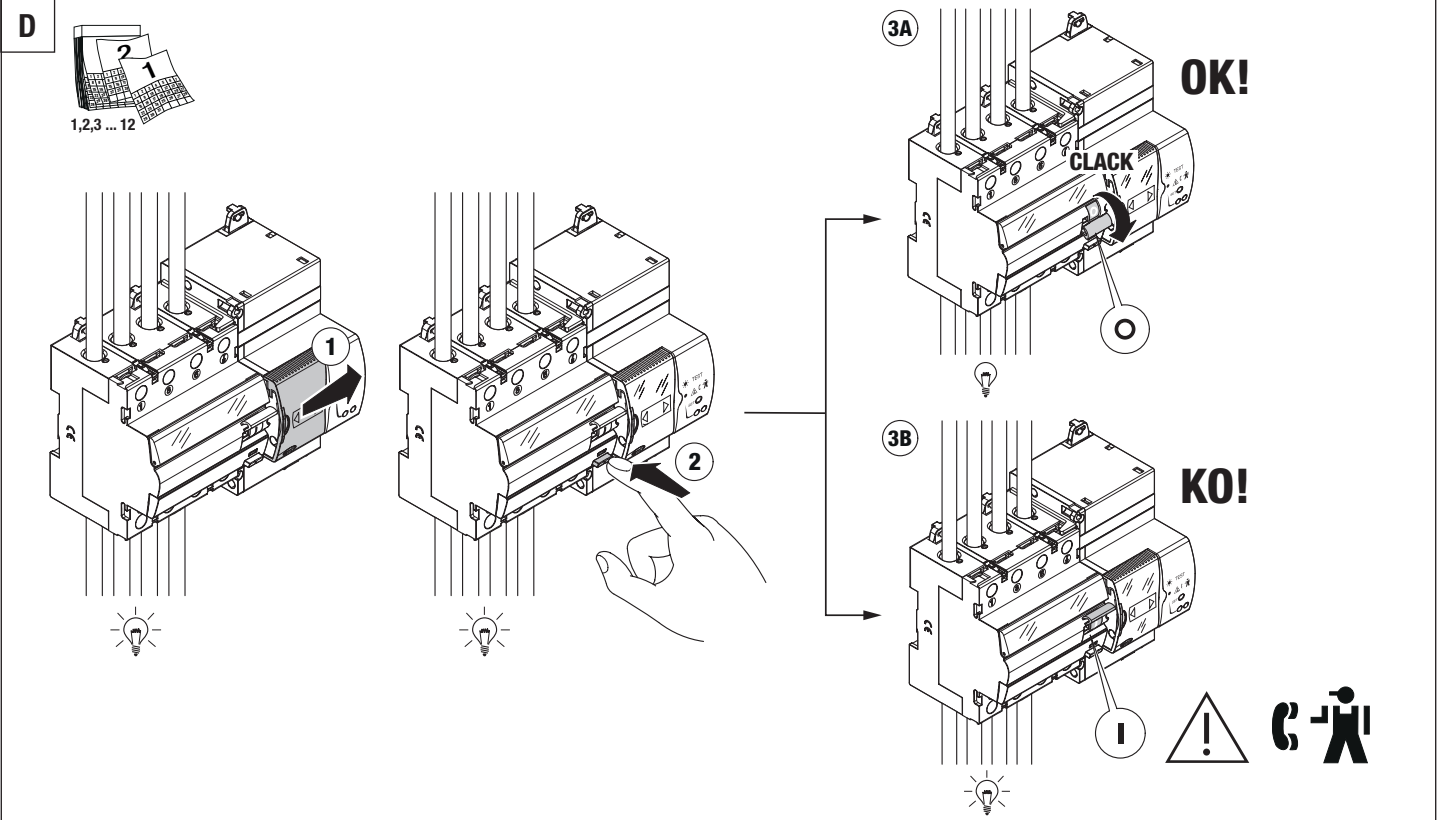

TEST RESTART

E

Diagram illustrating the test and restart procedure for the RESTART RD PRO circuit breaker.

Step 1: Press the test button (I). The breaker trips (O).

Step 2: Press the reset button (2). The breaker closes (I).

Step 3A: Press the test button (I). The breaker trips (O). **CLACK** $t < 10s$. (Green smiley face)

Step 3B: Press the test button (I). The breaker trips (O). **CLACK** $R < R_d$. (Red sad face)


Warning:

Wiring diagram showing the connection of the circuit breaker to the power supply (L, N, PE) and the load (R).


RESTART RD PRO		
	30mA	100/300/500 mA
Rd	16kΩ	5kΩ
Rdo	8kΩ	2,5kΩ

RESTART RD PRO




F

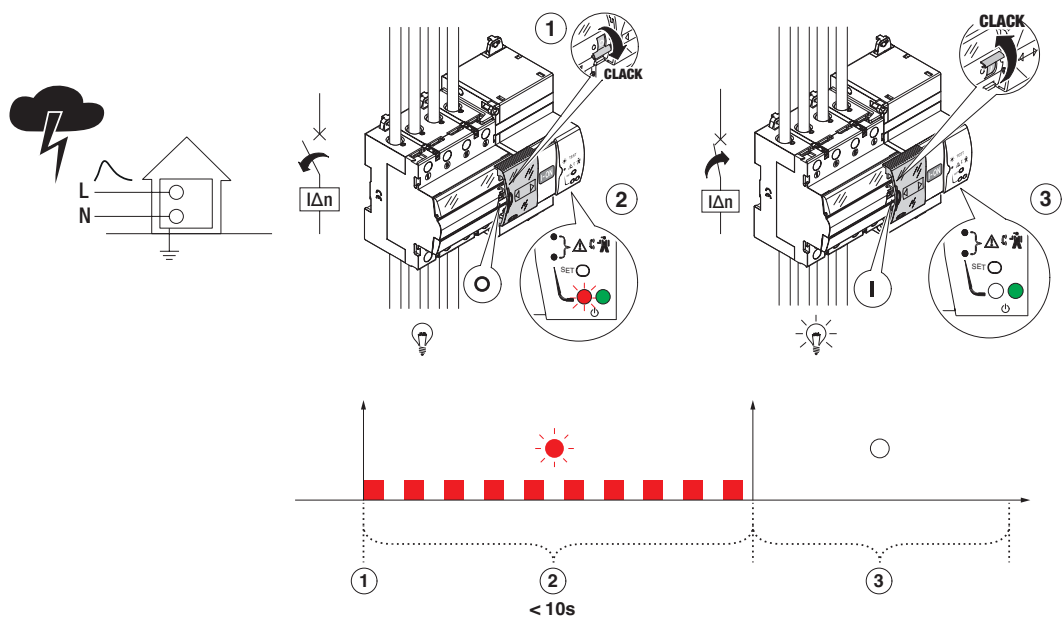










G

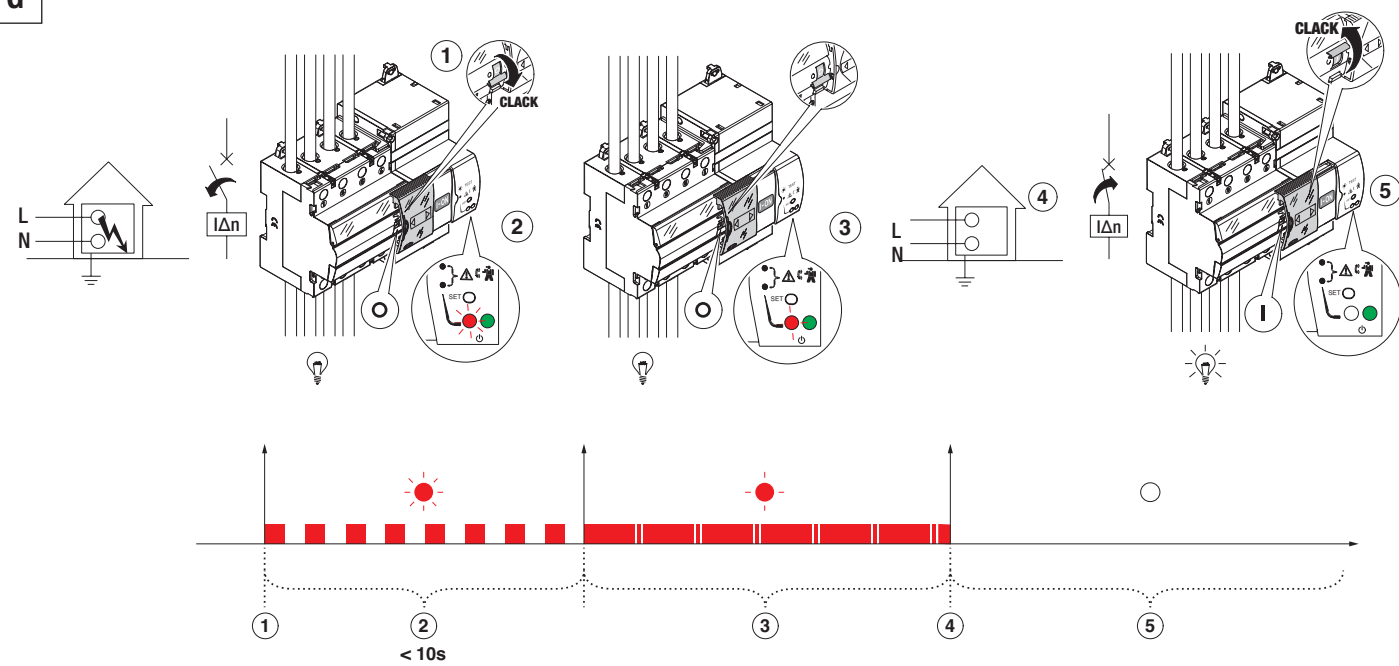



RESTART OFF

						
					MODE 1,2	MODE 3
		I-ON 			ON (t>15'')	OFF
		O-OFF 			OFF	ON

RESTART ON

						
					MODE 1,2	MODE 3
		I-ON 			OFF	OFF
		O-OFF 			OFF	ON
		O-OFF 			ON	ON
		O-OFF 			ON	ON
		I-ON O-OFF 			ON	OFF/ON

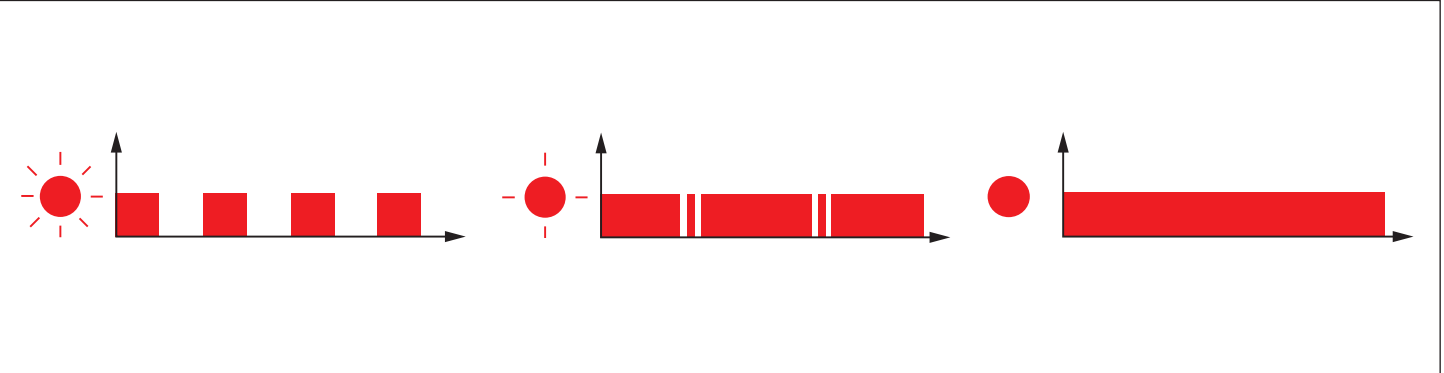

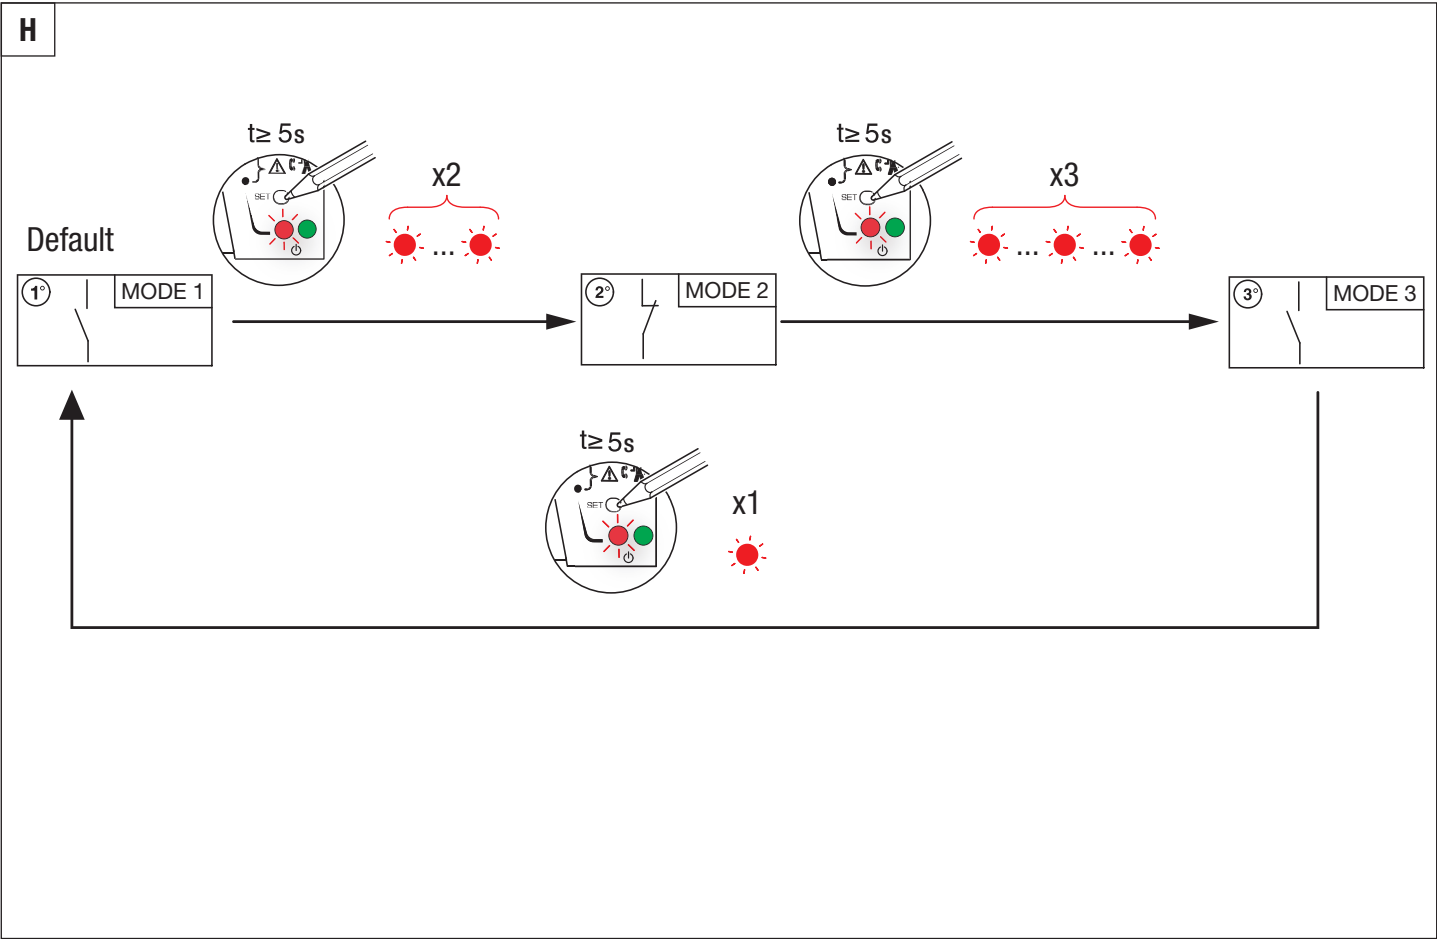



GW 90 967



+

IDP (GW D4XXX)				Approval
IΔn	Type	Poles		
		2P	4P	
30mA	AC / A	25÷63A	25÷63A	IMQ
	A[IR]	80÷100A	80÷100A	

GW 90 969




+


IDP (GW D4XXX)				Approval
IΔn	Type	Poles		
		2P	4P	
100mA	AC / A	25÷100A	25÷100A	
300mA	AC / A	25÷63A	25÷63A	IMQ
500mA	A[IR] / A[S]	80÷100A	80÷100A	



RESTART RD PRO 2P

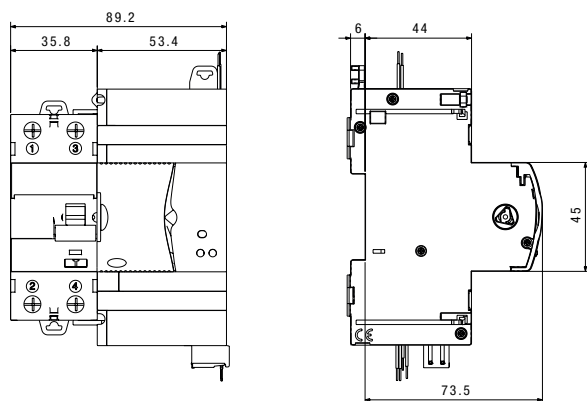

RESTART RD PRO 4P

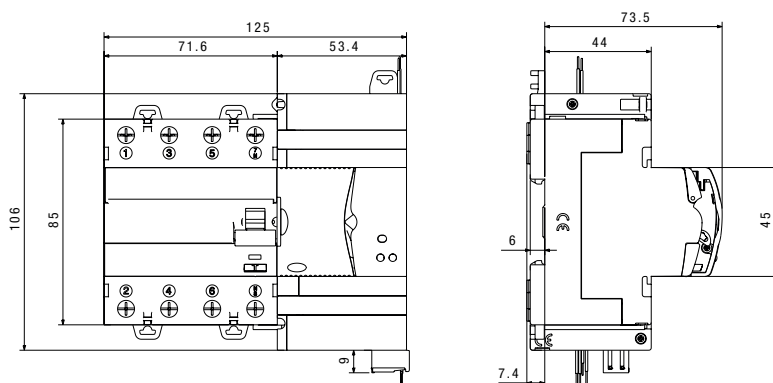

Ai sensi delle Decisioni e delle Direttive Europee applicabili, si informa che il responsabile dell'immissione del prodotto sul mercato Comunitario è:

According to the applicable Decisions and European Directives, the responsible for placing the apparatus on the Community market is:

GEWISS S.p.A. Via A.Volta, 1 IT-24069 Cenate Sotto (BG) Italy Tel: +39 035 946 111 Fax: +39 035 946 270 E-mail: qualitymarks@gewiss.com



+39 035 946 111

8.30 - 12.30 / 14.00 - 18.00
lunedì ÷ venerdì - monday ÷ friday



+39 035 946 260



sat@gewiss.com
www.gewiss.com